



TEMPERATURE CONTROLLERS... PORTABLE CHILLERS... CENTRAL CHILLERS... PUMP TANK STATIONS... TOWER SYSTEMS...

**SUBJECT: SECOND SETPOINT OPERATION IN SENTRA 'SK' AND REGAL 'RK' HE INSTRUMENTS**

#1-I-221

6/10/1997


The SENTRA SK and REGAL RK instruments are available with optional second setpoint capability. The second setpoint is activated by a contact closure between the red and black wires on the remote cable. The remote adjustable setpoint is activated by the input of 0-6 volts.




Sentra HE instrument



Regal HE instrument

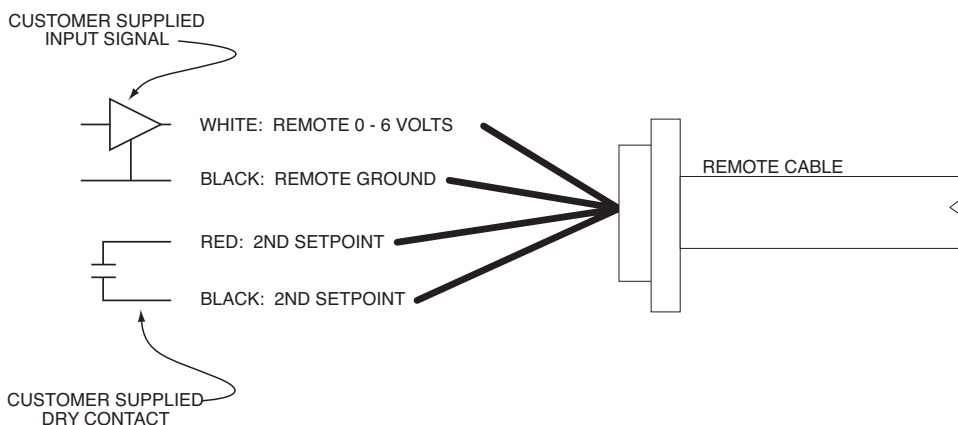

The instrument must be configured for second setpoint or remote setpoint before use. To access the extended configuration menu the second DIP switch (located on the top edge of the CPU board) must be toggled to the off position.

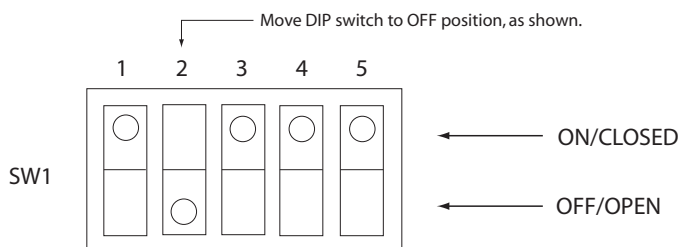

To activate the second setpoint function use the select key to access the "SP2" prompt in the extended menu. With the up arrow select 'yes' to enable the second setpoint option.

To activate the remote setpoint use the select key to access the "RSP" prompt in the extended menu. With the UP arrow select "yes" to enable the remote setpoint function.