



TEMPERATURE CONTROLLERS... PORTABLE CHILLERS... CENTRAL CHILLERS... PUMP TANK STATIONS... TOWER SYSTEMS...

SUBJECT: MK-2000 LE REMOTE START/STOP RELAY RETROFIT

#3-I-267

7/26/2002



We have discovered electrical interference introduced through the remote start/stop cables has led to instrument damage/failure.

To prevent this occurrence, we recommend the installation of isolation relays to separate the remote start/stop circuit from the remote cables and operators.

The following is a typical schematic detailing the wiring.

Two general purpose relays with 115 volt control coil, and one normally open contact are required.

Any questions should be directed to the **ADVANTAGE** Service Department at 317-887-0729.

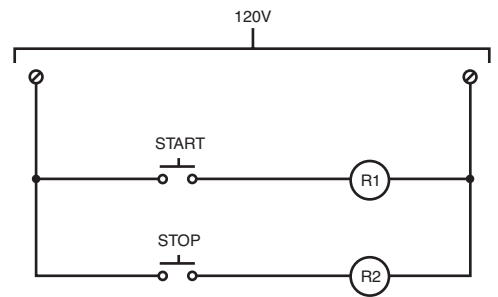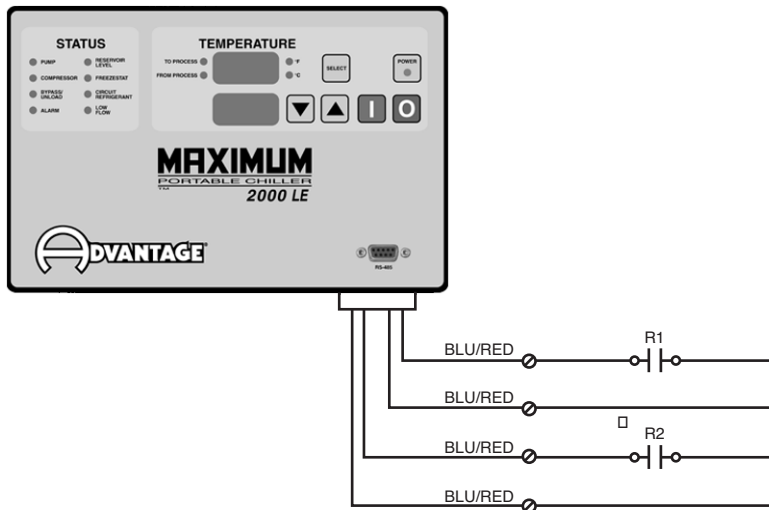

Start / Stop operators □ must be momentary contact only.